
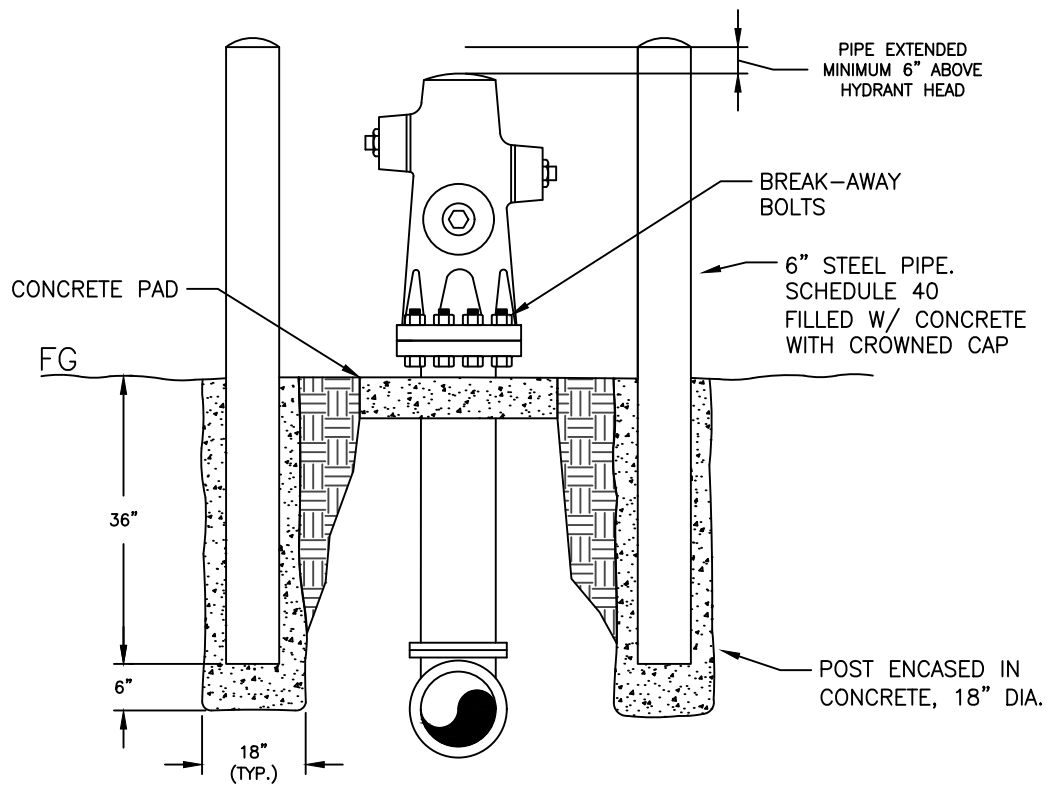


PLAN VIEW

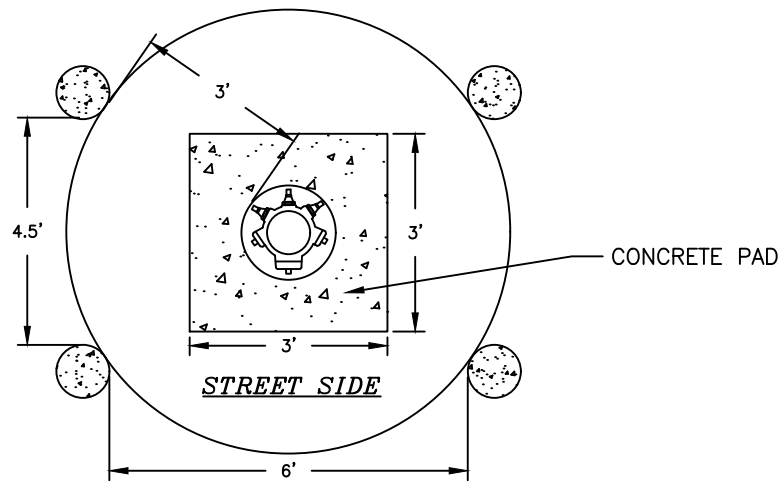

PROFILE VIEW

NOTES:

1. NUMBER & ORIENTATION OF BOLLARDS MAY BE CHANGED ACCORDING TO FIELD CONDITIONS WITH FOWD APPROVAL.
2. BOLLARDS AND HYDRANT ARE TO BE PAINTED WHITE PER FOWD STANDARD SPECIFICATIONS.
3. A MINIMUM OF 3 FEET CLEARANCE AROUND THE HYDRANT IS REQUIRED. THERE SHALL BE NOTHING AROUND THE HYDRANT THAT WOULD IMPAIR THE ABILITY TO SEE OR OPERATE THE HYDRANT.
4. CONCRETE SPLASH PAD SHALL BE 3'x3'x6" THICK PER FOWD STD-9.
5. BOLLARD STANDARD MAY BE APPLIED TO OTHER FOWD INFRASTRUCTURE, AS REQUIRED.

FAIR OAKS WATER DISTRICT

10326 FAIR OAKS BLVD., FAIR OAKS, CA 95628
OFFICE: (916) 967-5723
WEBSITE: WWW.FOWD.COM



FAIR OAKS
WATER DISTRICT

FIRE HYDRANT BOLLARDS

STANDARD DRAWING 9-1

APPROVED:	B. CHETCUTI
DRAWN BY:	D. LEE
DRAWING:	STD-9-1
REVISED:	JUNE 2026
SCALE:	NONE

STANDARD SPECIFICATIONS